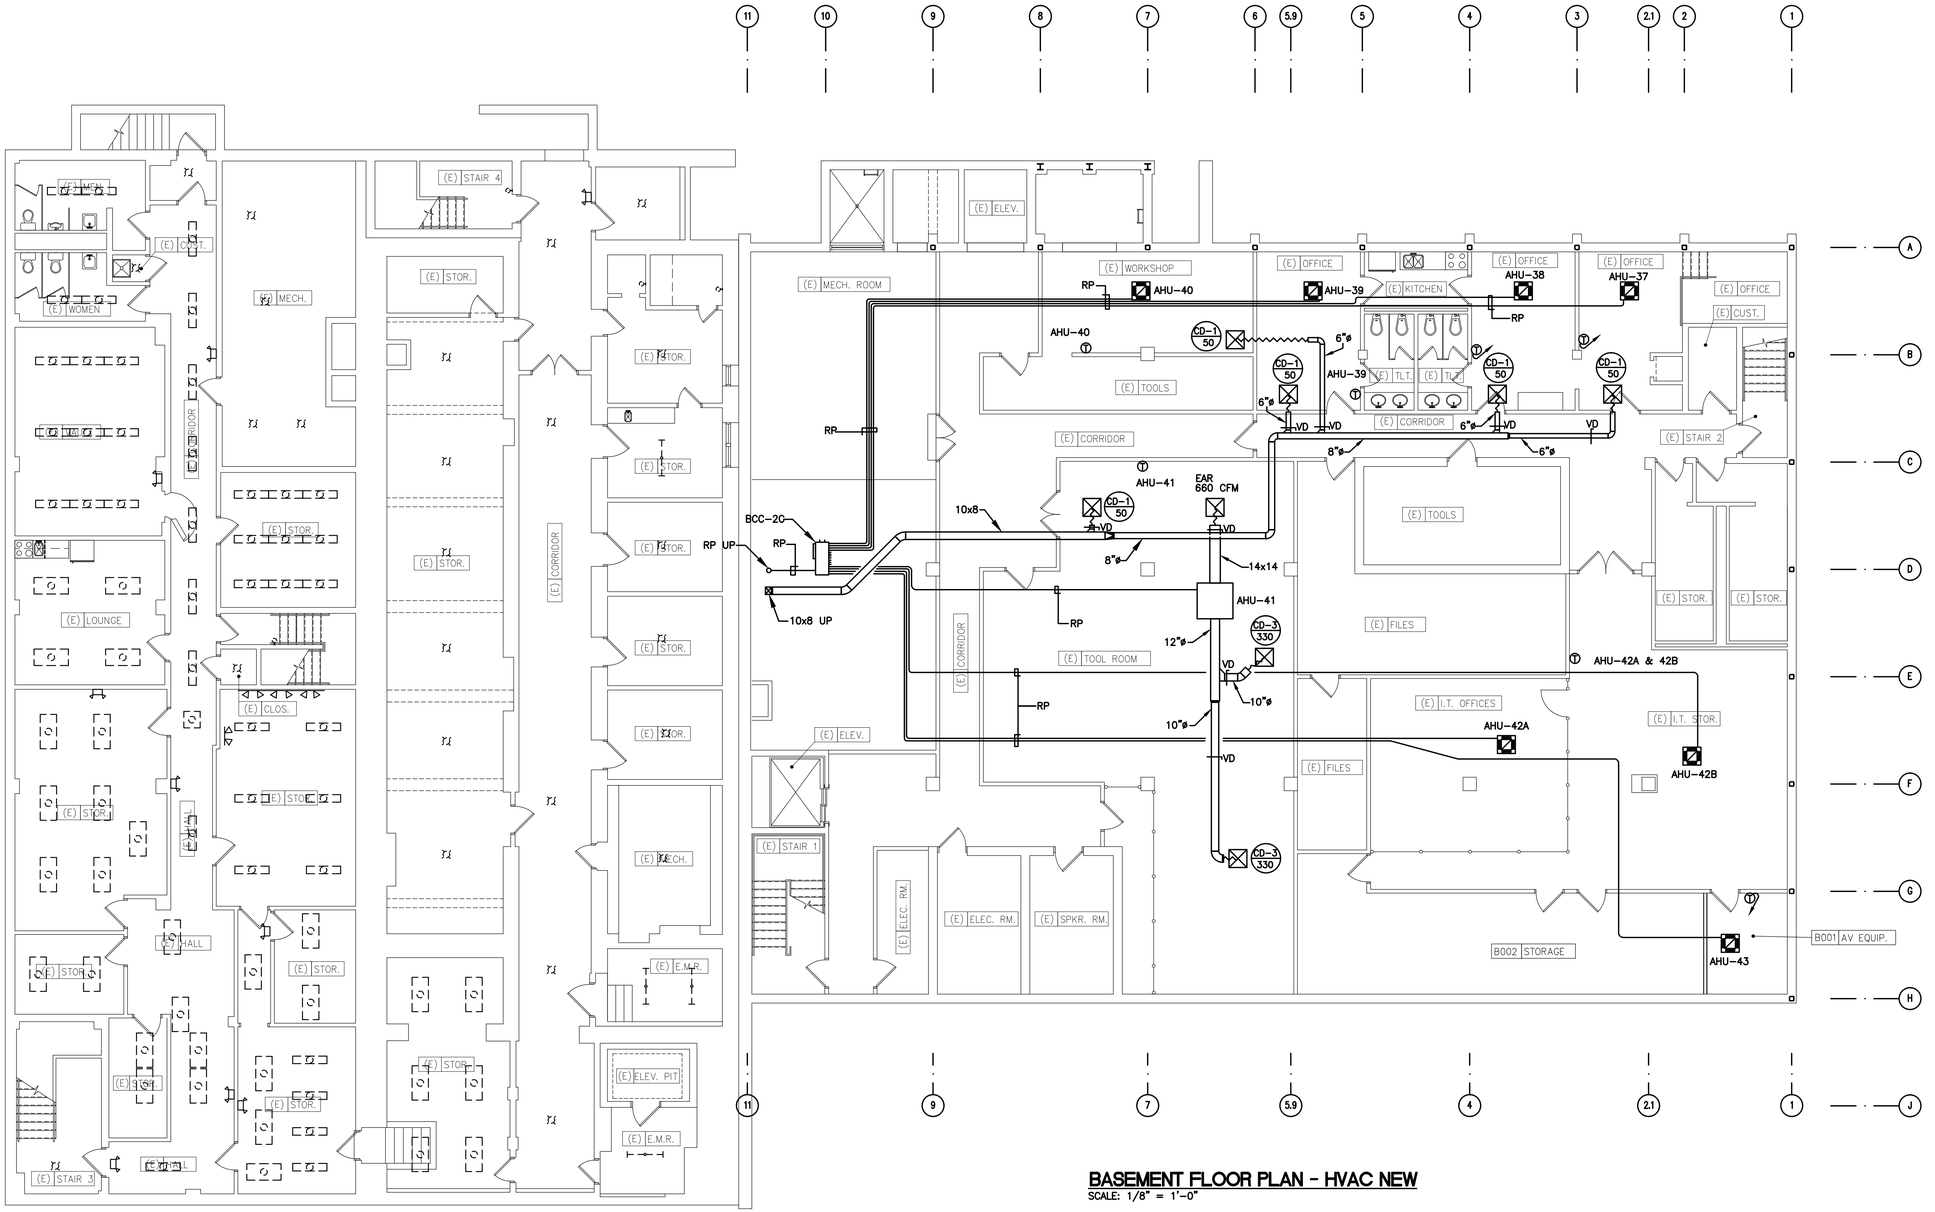

BASEMENT FLOOR PLAN - HVAC NEW

SCALE: 1/8" = 1'-0"

GENERAL NOTE:

G1. ALL REFRIGERANT PIPING SHALL BE SIZED PER MANUFACTURER REQUIREMENTS.

1/8" = 1'-0" SCALE 5 0 5 10 15 20 FEET

NORTH

RHL ENGINEERING COMPANY, INC.
3 West Second Street
Frederick, Md. 21701
OFFICE: (301) 695-9424
FAX: (301) 293-6338
E-mail:rhlengr@rhlengr.com

Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No:45511 Expiration Date: 06/03/2016

BUSHEY FEIGHT MORIN ARCHITECTS INC.
473 North Potomac Street, Hagerstown, Md 21740
301-733-5600 Fax 301-733-5612
E-mail: BFM@BFMArchitects.com

copyright 2014, Bushey Feight Morin Architects, Inc.

BFM No. 14028 WASH. CO. ADMINISTRATION COMPLEX
RHL No. 13208 FIRST FLOOR RENOVATIONS

BID DOCUMENTS

BASEMENT FLOOR PLAN-HVAC NEW

M1.1

3 OF 12 SHEETS

DATE : 08.15.14