





RHL ENGINEERING COMPANY, INC.
 3 West Second Street
 Frederick, Md. 21701
 OFFICE: (301) 695-9424
 FAX: (301) 293-6338
 E-mail: rhlengr@rhlengr.com


Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland License No. 45511 Expiration Date: 06/03/2018



BUSHEY FEIGHT MORIN ARCHITECTS INC.
 473 North Potomac Street, Hagerstown, Md 21740
 301-733-5600 Fax 301-733-5612
 E-mail: BFM@BFMArchitects.com

copyright 2014, Bushey Feight Morin Architects, Inc.
BFM
 BUSHEY FEIGHT MORIN ARCHITECTS INC.
 WASH. CO. ADMINISTRATION COMPLEX
 FIRST FLOOR RENOVATIONS

BID DOCUMENTS
 FIRST FLOOR PLAN - NEW
P1.1
 3 OF 5 SHEETS
 DATE : 08.15.14

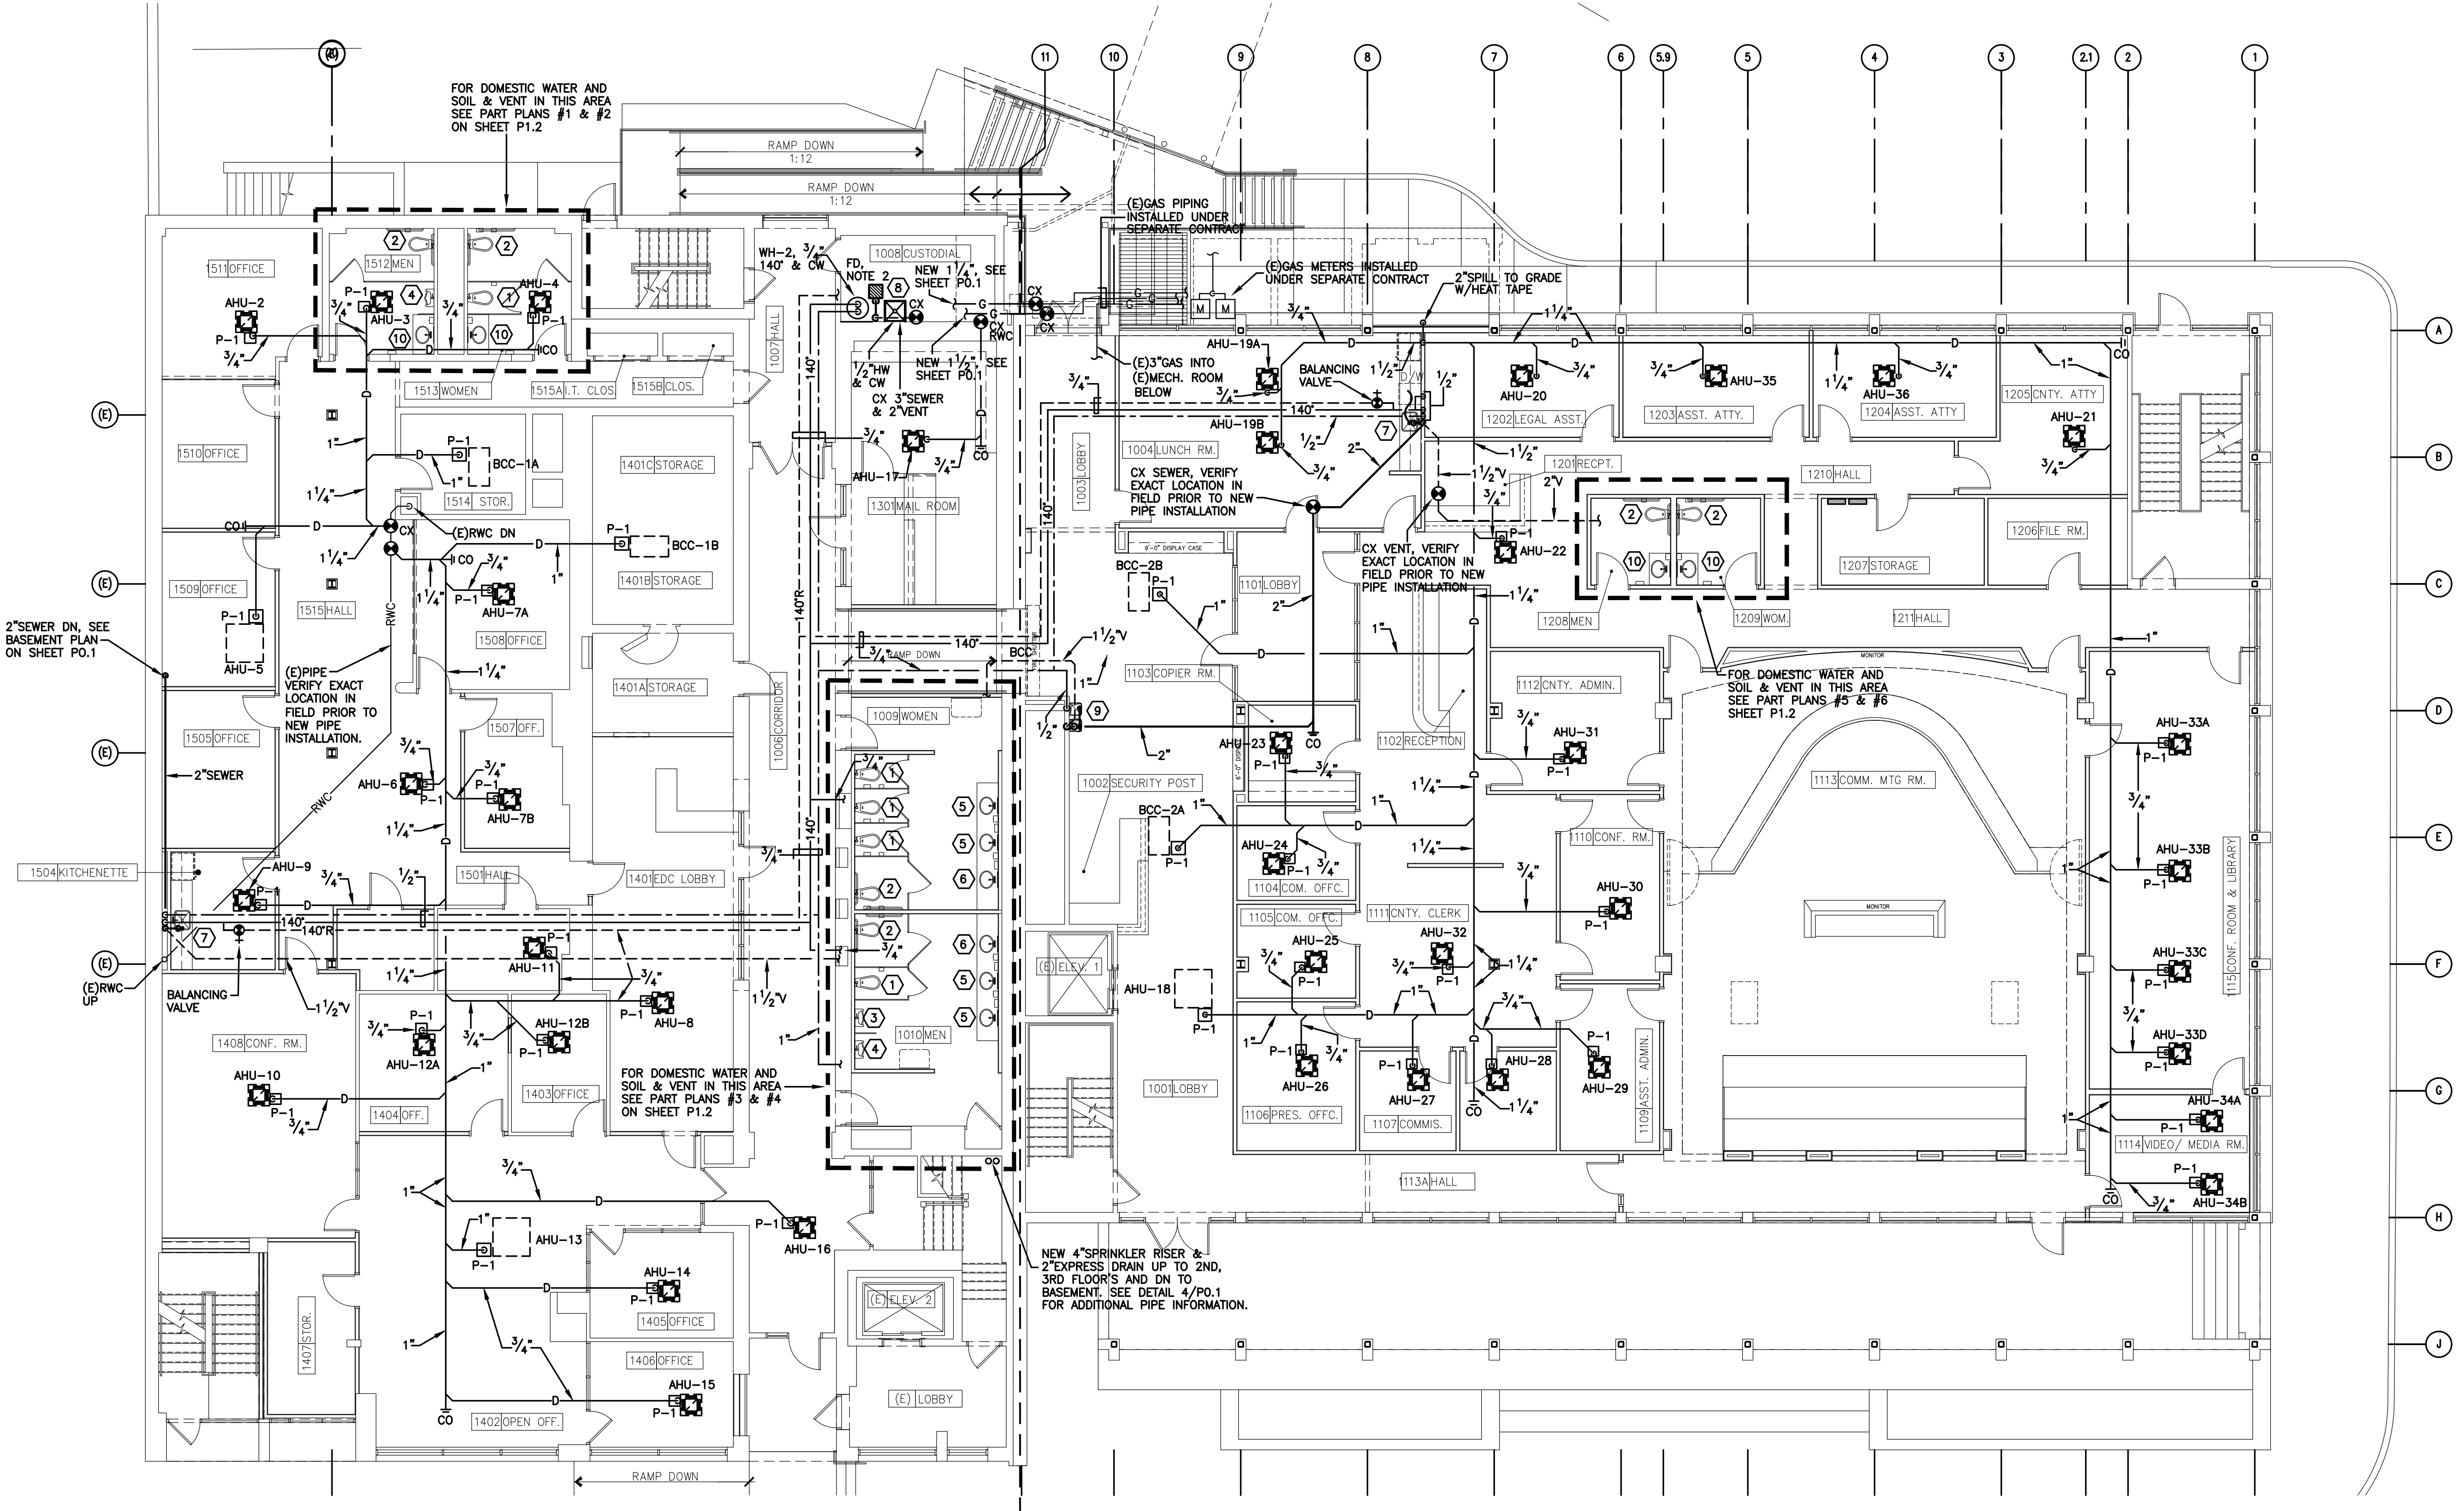

EXISTING BUILDING TO BE SPRINKLED (SEE SPRINKLER NOTE) ←
 ← SEE NOTE 1
 → SEE NOTE 1
 → EXISTING BUILDING SPRINKLED (SEE SPRINKLER NOTE)

FIRST FLOOR PLAN - PLUMBING/PIPING
 SCALE: 1/8"=1'-0"
 NOTE 1: ALL AHU'S HAVE BUILT-IN PUMP UNLESS NOTED OTHERWISE.
 NOTE 2: PROVIDE "PRO VENT" TRAP SEAL SYSTEM.

SPRINKLER SYSTEM NOTE
 NOTE: REVISE/EXTEND EXISTING SPRINKLER PIPE SYSTEM, MODIFY, RELOCATE PIPE, ADD HEADS AS NECESSARY TO ACCOMMODATE NEW TENANT WALL LAYOUT AS REQUIRED. PROVIDE SPRINKLER DRAWING TO FIRE MARSHAL. INSTALL PER NFPA 13 AND COORDINATE INSTALLATION WITH LOCAL FIRE MARSHAL. BLDG 120 TO RECEIVE NEW SPRINKLER ZONE FOR ALL FLOORS, BLDG 100 IS EXISTING TO BE MODIFIED.

